



**EXAMPLE OF CRUDE OIL TANK BATTERY DIAGRAM
A/K/A TIER 2 SITE MAP**

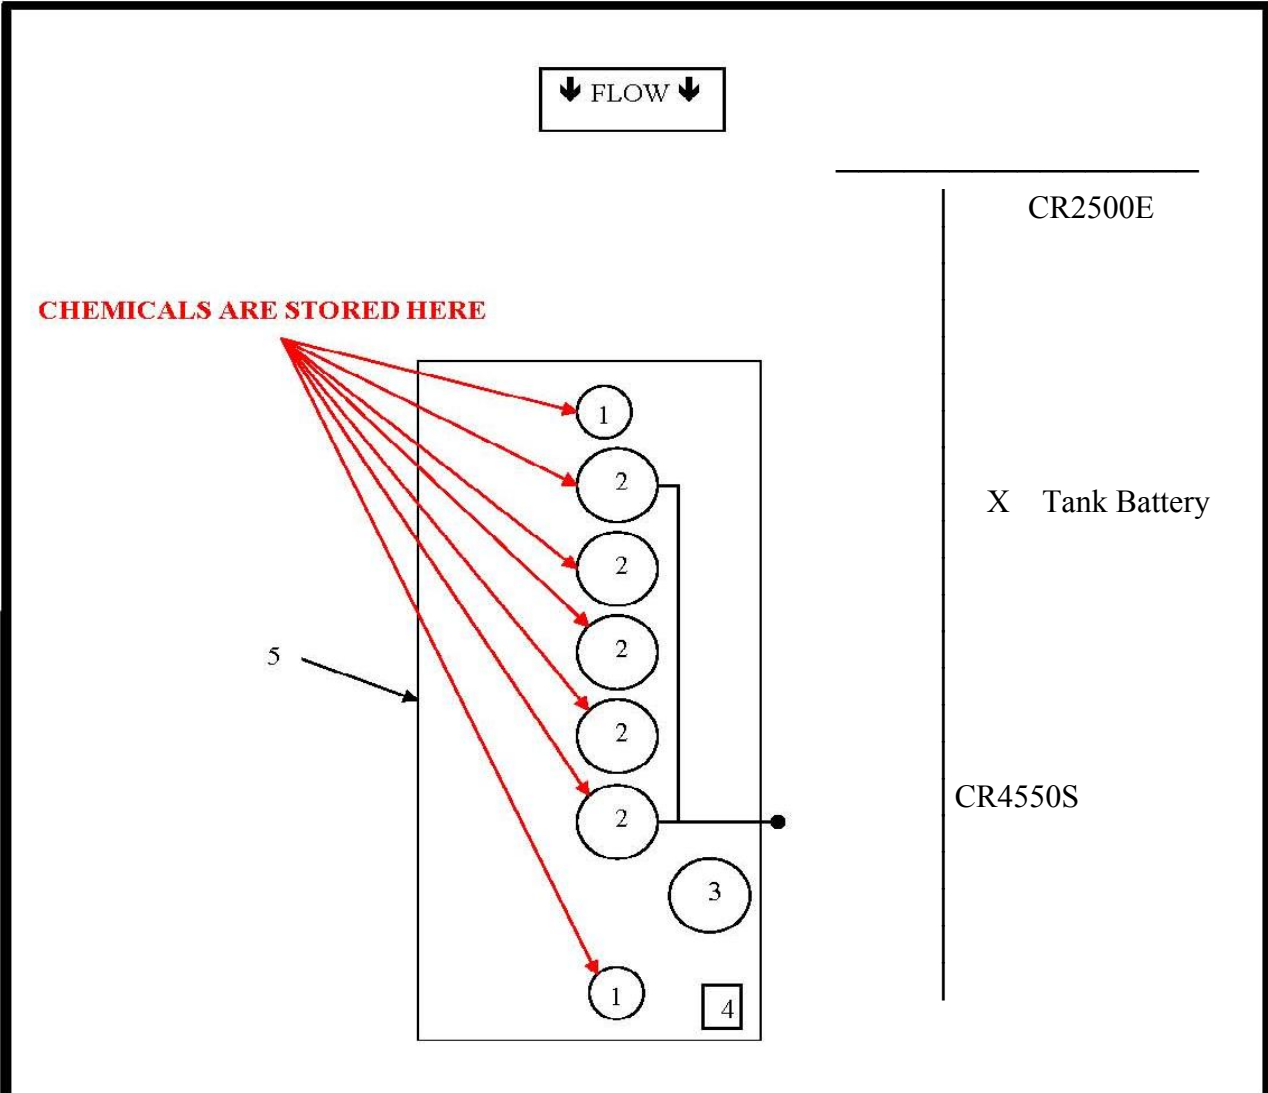

1. Welded Steel 5'x20'70 BBL Gun Barrel
2. Welded Steel 10'x15' 210 BBL Storage Tank
3. Fiberglass 10'x15' 210 BBL Storage Tank
4. Sump
5. 40'x120'x2.0' Earthen Containment Berm



IN ADDITION TO THE DIAGRAM AND KEY, PLEASE INCLUDE:

- DATE
- FACILITY NAME
- FACILITY/ 9-1-1 ADDRESS*
- FACILITY TIER 2 MANAGER USERNAME
- LATITUDE/LONGITUDE
- THE ROOF TYPE OF EACH CONTAINER,
- HOW MANY GALLONS OF CRUDE & WATER THE BERM WILL HOLD, AND
- WHERE THE NEAREST WATER SOURCE IS LOCATED

****IF YOUR FACILITY DOES NOT HAVE A 9-1-1 ADDRESS, THE NEAREST CROSSROADS MUST BE NOTED SOMEWHERE ON THE MAP.***